


09/15/17 AM
11/14/03
C:\19750\9750412.dgn

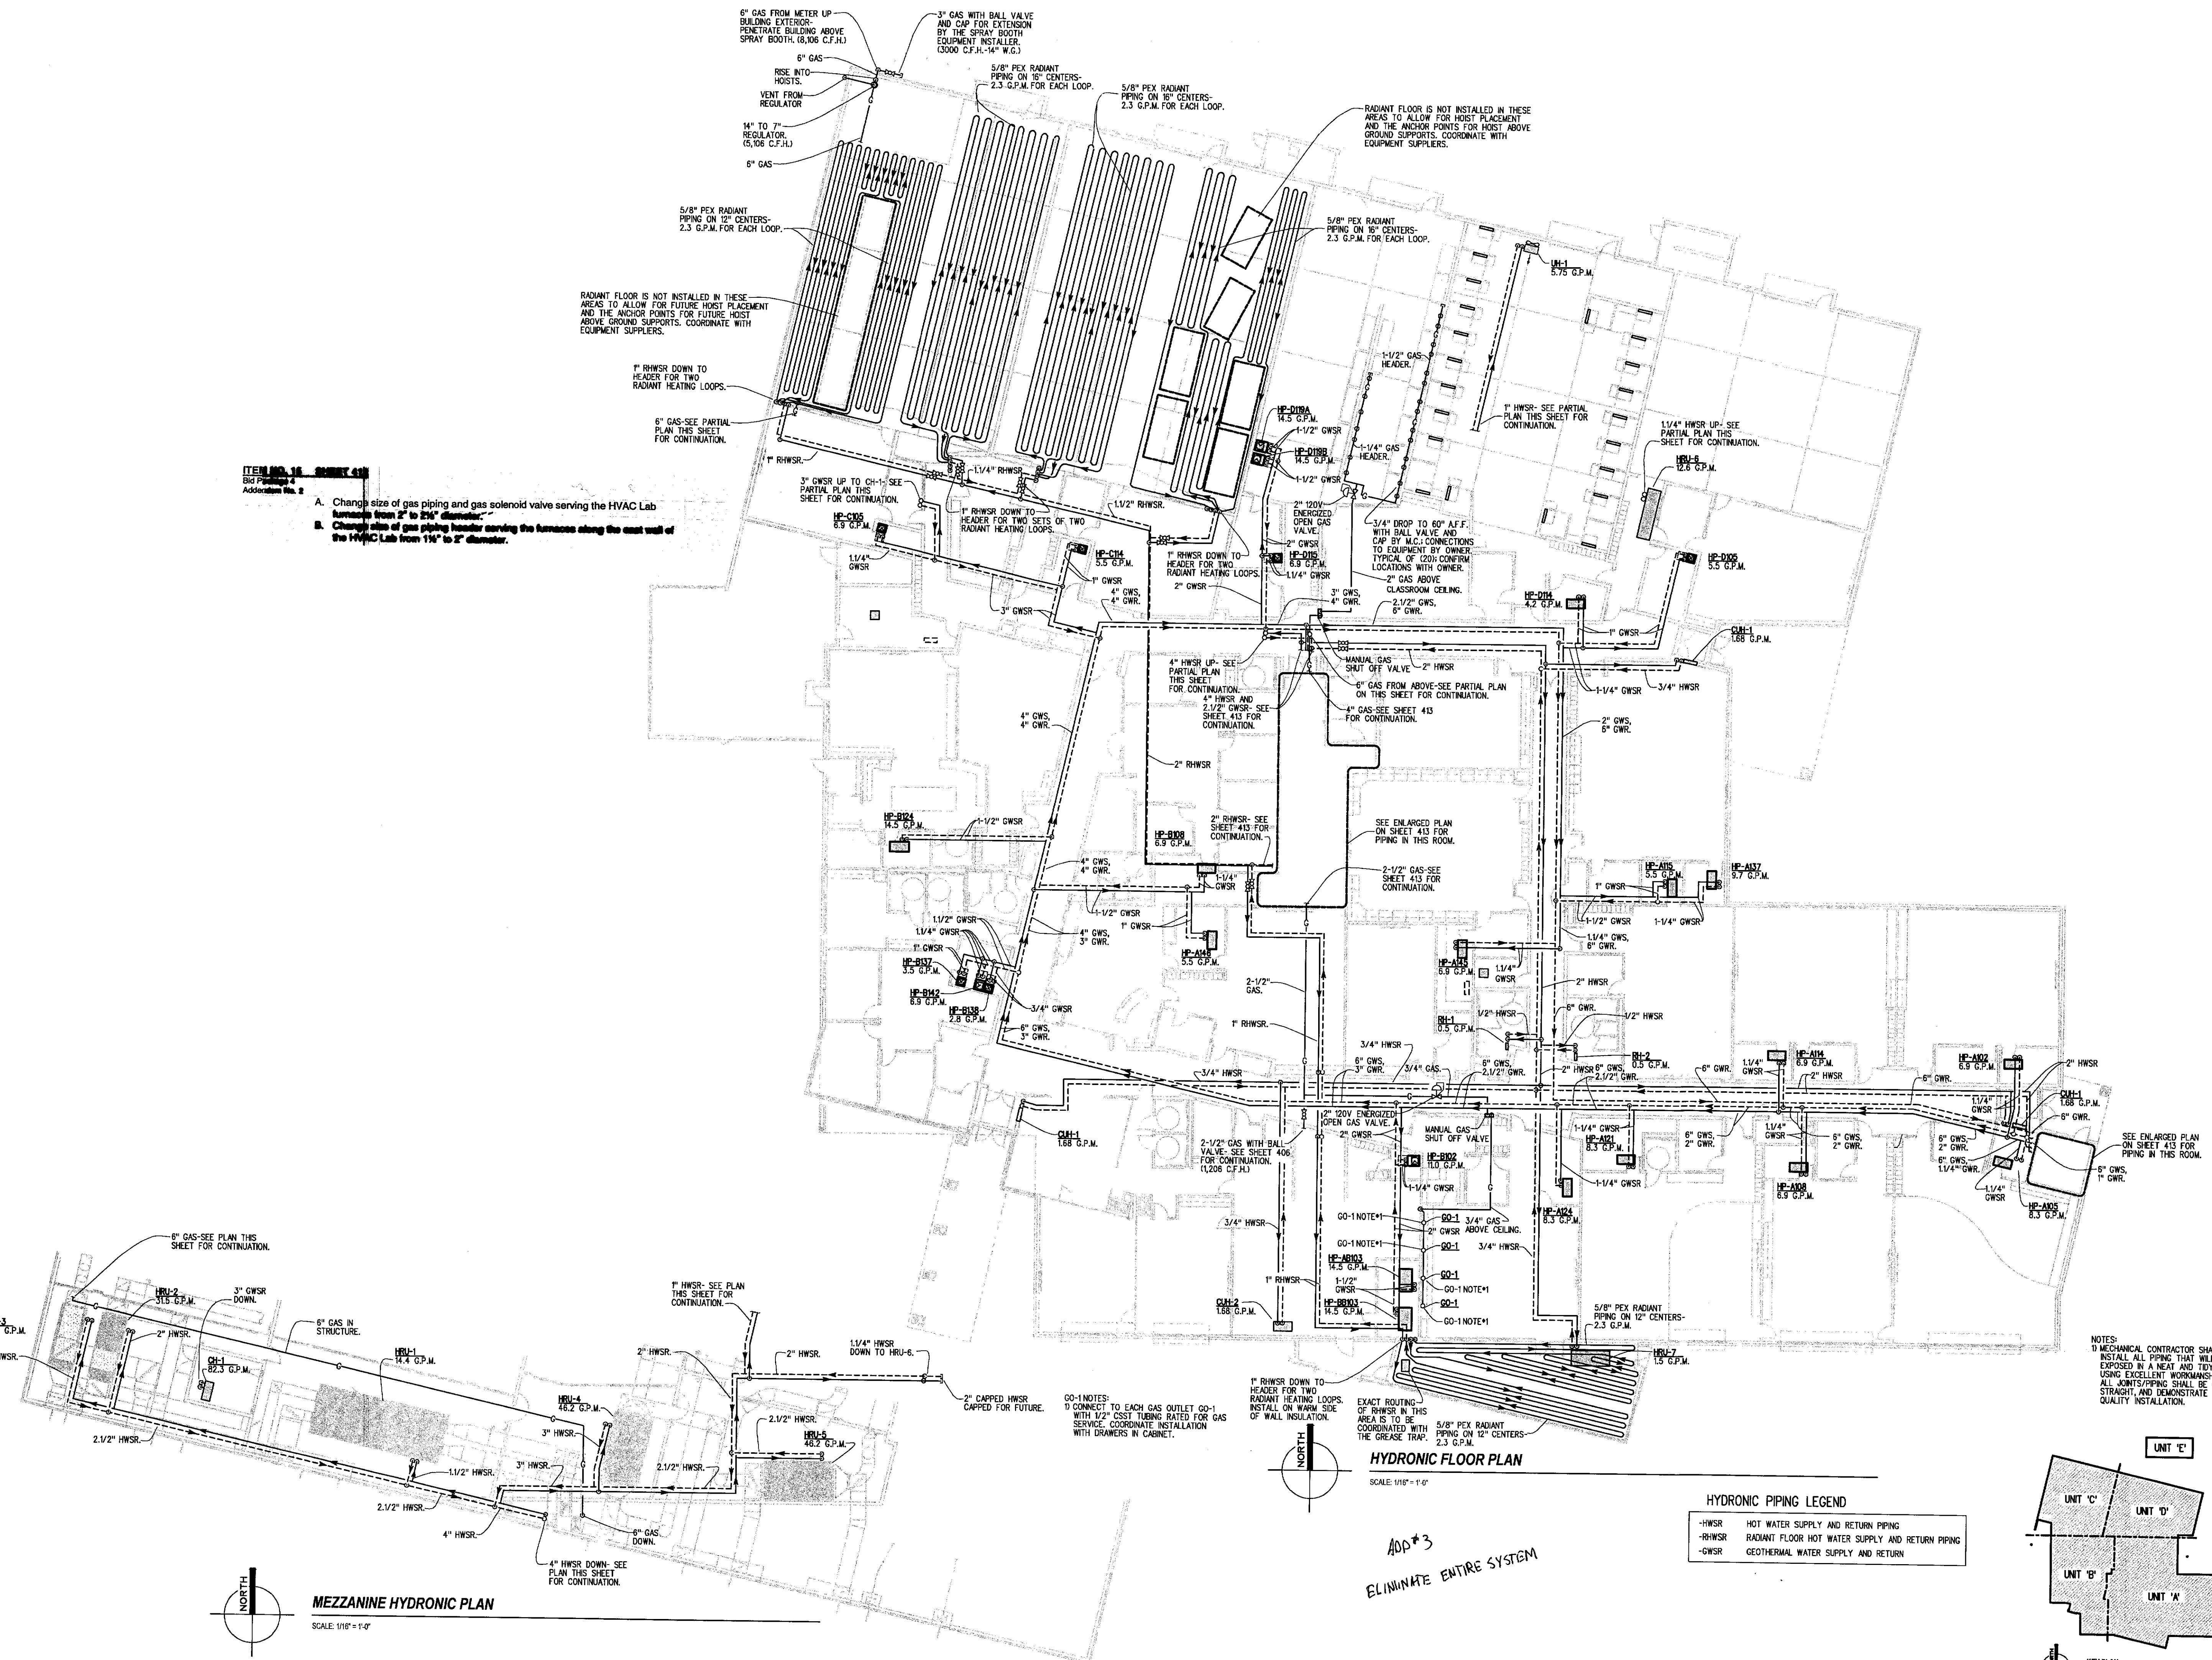

ITEM NO. 16 - CHANGE 01
 516 Package 4
 Addendum No. 2


A. Change size of gas piping and gas solenoid valve serving the HVAC Lab furnace from 2" to 2 1/2" diameter.
 B. Change size of gas piping header serving the furnaces along the east wall of the HVAC Lab from 1 1/4" to 2" diameter.

MEZZANINE HYDRONIC PLAN
 SCALE: 1/16" = 1'-0"

HYDRONIC FLOOR PLAN
 SCALE: 1/16" = 1'-0"

HYDRONIC PIPING LEGEND

- HWSR HOT WATER SUPPLY AND RETURN PIPING
- RHWSR RADIANT FLOOR HOT WATER SUPPLY AND RETURN PIPING
- GWSR GEOTHERMAL WATER SUPPLY AND RETURN

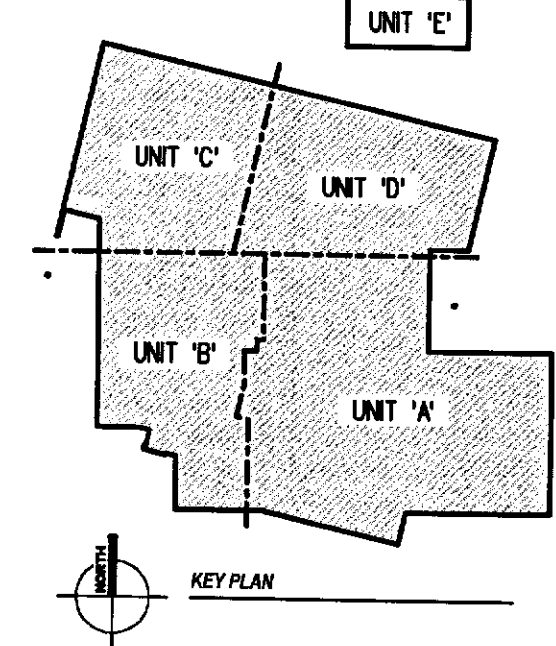

ADD #3
 ELIMINATE ENTIRE SYSTEM

410 terrace plaza
 muskegon, mi 49440
 231.723.3407 voice
 231.723.2589 fax
 www.hookerdejong.com

HOOKER | DE JONG
 architects & engineers

Muskegon Area
 Career Tech Center
MAISD / MCC
 Muskegon Michigan

| | |
|--|----------|
| PROJECT NO. | 9760 |
| ISSUANCES | |
| BIDDING & CONSTRUCTION | 11/14/03 |
| REVISIONS | |
| Copyright © 2003 Hooker DeJong Architects-Engineers, All Rights Reserved | |
| APPROVED BY | |
| REVIEWED BY | RAB |
| DRAWN BY | TDK |

HYDRONIC & NATURAL GAS PIPING PLAN

412